

LILING

Line Post Insulator




PT. SURYA TOTAL PERTIWI
INDUSTRY & SUPPLIER

Jl.Sunter Paradise Blok F12 No.1
Sunter Podomoro – Jakarta Utara 14350
Telp.(021) 65307382 / Fax (021) 6516120

Jl.Danau Sunter Utara B1A No.15
Sunter Agung – Jakarta Utara 14350
Website:www.suryatotalpertiwi.com

Email : info@suryatotalpertiwi.com

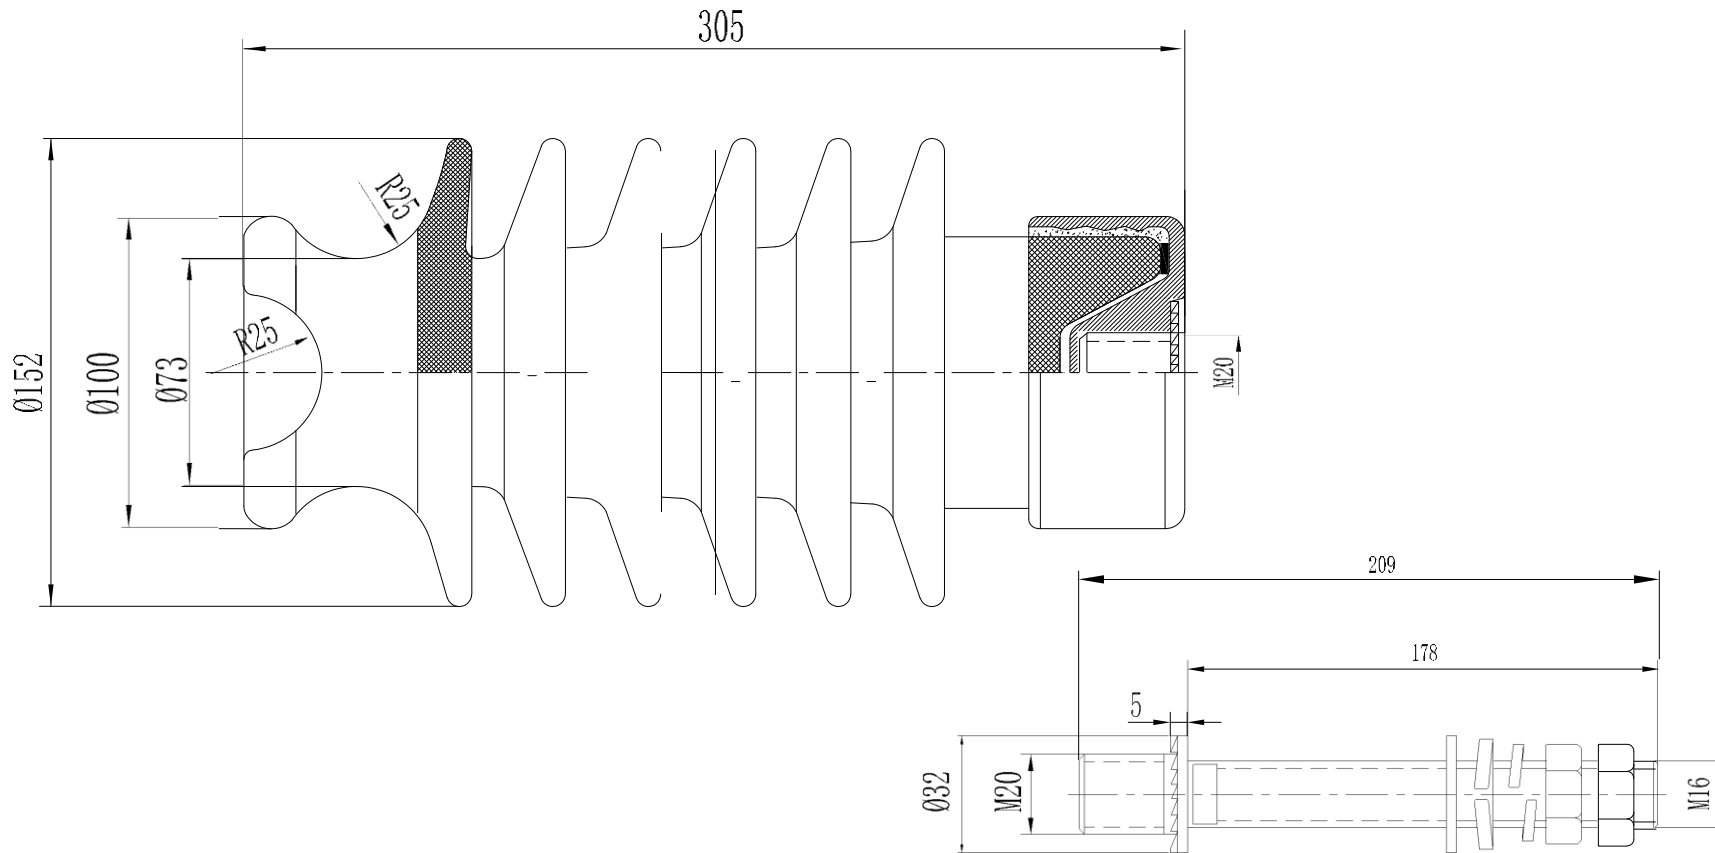

Technical requirements:

1. Colour: brown
2. Creepage distance: 559mm
3. Cantilever strength: 12.5kN
4. Low frequency dry flashover voltage: 100KV
5. Low frequency wet flashover voltage: 70KV
6. Critical impulse flashover voltage(positive): 160KV
8. Insulator material: Porcelain
9. As per ANST C29.7-1996

				20kv line post insulator			I.TI.TNG DONGFANG ELECTROCERAMIC CO., LTD.	
Mark	Modify	Sign	Date	Weight		Scale		
				ANSI 57-2L				