

# **OUT-DOOR POLYMER TYPE ISOLATE-SWITCH**

**1 POLE, 24 KV, 630 A, 50 HZ, TYPE – DS – P**



**DS – P – 24 Out door Polymer, Pole Mounted Isolate Switch (Disconnecting Switch)**

**Digunakan pada sistem saluran udara 24KV, 50HZ.**

**Dioperasikan pada keadaan tegangan padam.**

**Lokasi dengan ketinggian maximum 2500 Meter diatas permukaan laut.**

**Suhu udara antara -25°C hingga +40°C**

---

## **PT. SURYA TOTAL PERTIWI**

**INDUSTRY & SUPPLIER**

Jl. Danau Sunter Utara B1A/15

Sunter Agung - Jakarta Utara 14350

Telp. (021) 65307382 / Fax (021) 6516120

E-mail: [info@suryatotalpertiwi.com](mailto:info@suryatotalpertiwi.com)

website : [www.suryatotalpertiwi.com](http://www.suryatotalpertiwi.com)

**DISTRIBUTOR :**

**ANDALAN LISTRIK**

Gedung HWI Lindeteves

Lt. 3 Blok A


Jakarta Barat 11180

Telp/Fax. 021 – 62303503

## Technical Specification

No	ITEM	Unit	Rating
1.	Rated Voltage	Kv	24
2.	Rated Current	A	630
3.	4 s Short-Time withstand Current	KA	16
4.	Peak Value Withstand Current	KA	40
5.	PF Withstand Voltage (1 min) Wet	Kv	55
6.	PF Withstand Voltage (1 min) Dry	Kv	75
7.	Lightning Impules-Polarity to Earth	Kv	124
8.	Lightning Impules-between Gaps	Kv	145

### Structure and Voltage

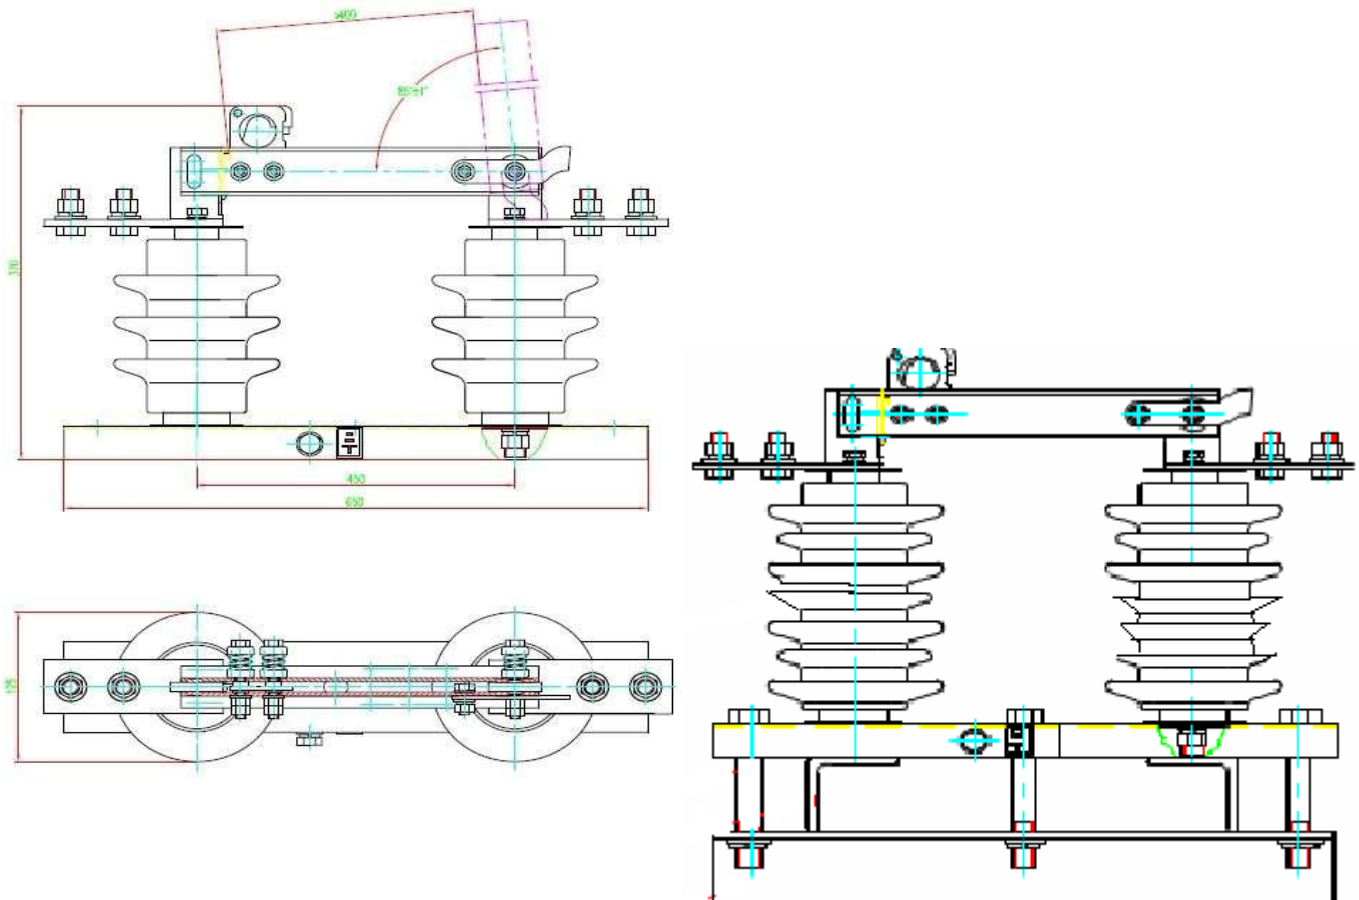

**PT. SURYA TOTAL PERTIWI**  
 INDUSTRY & SUPPLIER  
 Jl. Danau Sunter Utara B1A/15  
 Sunter Agung - Jakarta Utara 14350  
 Telp. (021) 65307382 / Fax (021) 6516120  
 E-mail: [info@suryatotalpertiwi.com](mailto:info@suryatotalpertiwi.com)  
 website : [www.suryatotalpertiwi.com](http://www.suryatotalpertiwi.com)

**DISTRIBUTOR :**  
**ANDALAN LISTRIK**  
 Gedung HWI Lindeteves  
 Lt. 3 Blok A  
 Jakarta Barat 11180  
 Telp/Fax. 021 – 62303503